



Laboratory for Acoustics



Determination of the sound absorption (reverberation room method) of HeartFelt® Linear Panels, manufacturer Hunter Douglas Europe B.V.



Laboratory for Acoustics

Determination of the sound absorption (reverberation room method) of HeartFelt® Linear Panels, manufacturer Hunter Douglas Europe B.V.

Principal Hunter Douglas Europe B.V. - Rotterdam
 P.O. Box 5072
 3008 AB Rotterdam (The Netherlands)
Report number A 3211-1E-RA-001
Date January 20, 2017
Reference TS/RA/KF/A 3211-1E-RA-001
Representative Th.W. Scheers
Author R.T. Allan
 +31 24 3570749
 r.allan@peutz.nl

peutz bv, postbus 66, 6585 zh mook, +31 24 357 07 07, info@peutz.nl, www.peutz.nl

All orders are accepted and executed according to 'De Nieuwe Regeling 2011' (The New Rules)

BTW NL004933837B01 KvK: 12028033

mook – zoetermeer – groningen – düsseldorf – dortmund – berlijn – leuven – parijs – lyon



Table of contents

1 Introduction	4
2 Standards and guidelines	5
3 Tested constructions	6
4 Measurements	8
4.1 Method	8
4.2 Accuracy	10
4.3 Environmental conditions during the measurements	10
4.4 Results	10



1 Introduction

At the request of Hunter Douglas based in Rotterdam (The Netherlands), laboratory measurements of the sound absorption (reverberation room method) were carried out on:

**HeartFelt® Linear Panels,
manufacturer Hunter Douglas Europe B.V.**

in the Laboratory for Acoustics of Peutz bv, at Mook, the Netherlands (see figure 1).



For these type of measurements the Laboratory for Acoustics has been accredited by the Dutch Accreditation Council (RvA).

The RvA is member of the EA MLA (**EA MLA: European Accreditation Organisation MultiLateral Agreement**: <http://www.european-accreditation.org>).

EA: "Certificates and reports issued by bodies accredited by MLA and MRA members are considered to have the same degree of credibility, and are accepted in MLA and MRA countries."



2 Standards and guidelines

The measurements have been carried out according to the Quality Manual of the Laboratory for Acoustics as well as:

ISO 354:2003¹
NOTE: Acoustics Measurement of sound absorption in a reverberation room
this international standard has been accepted within all EU-countries
as European standard EN ISO 354:2003

Various other related norms:

EN ISO 11654:1997 Acoustics Sound absorbers for use in buildings Rating of sound absorption

ASTM C423-09a Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method

1 According to this norm, the report should include for each measurement the mean reverberation times T_1 and T_2 at each frequency. Because these figures are not relevant for judging the quality of the product being tested, but merely for judging the accuracy of the calculations, they have been omitted in this report. It is possible of course to reproduce those figures at any time if the principal requests this.

3 Tested constructions

The test specimen is placed directly on the floor of the reverberation room by the principal. The data presented here have been received from the principal or obtained by own observations.

Measurements have been carried out on:


HeartFelt® panels:

type:	HeartFelt® Panels
manufacturer:	Hunter Douglas Europe B.V.
panel sizes:	a square edged U-profile height 55 mm, width 40 mm
material:	Trevira Polyester fiber felt
weight:	130 g/m

The ceiling panels are fixed on omega-profiles with a height of ca. 40 mm.



f3.1 HeartFelt® panels

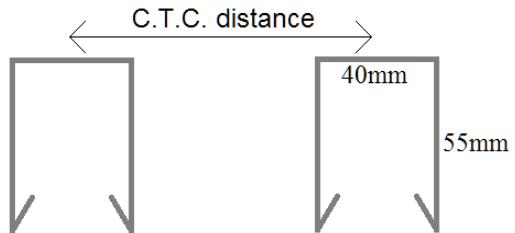

f3.2 Dimensions of the HeartFelt® panels

Eight different configurations were tested;


built up height [mm]	c.t.c. distance panels [mm]	extra
200	42	
200	60	
200	70	
200	70	fiber felt joint filler on panels, cavity side (0,600 kg/m ³)
200	70	22 mm thick glass wool on panels, cavity side (2,08 kg/m ³)
200	80	
200	80	fiber felt joint filler between panels (0,600 kg/m ³)
200	90	

The results as presented here relate only to the tested items and laboratory conditions as described in this report. The laboratory can make no judgement about the representativity of the tested samples. The test report ahead is valid as long as the tested constructions and/or materials are unchanged.

4 Measurements

The ceiling panels to be measured (see chapter 3) are mounted on a support structure above the floor of the reverberation room, the facing side of the panels was up.

The sides of the set-up were enclosed by 18 mm thick plastic covered chipwood board and sealed by tape. The total construction height (figure f4.1) is 200 mm.

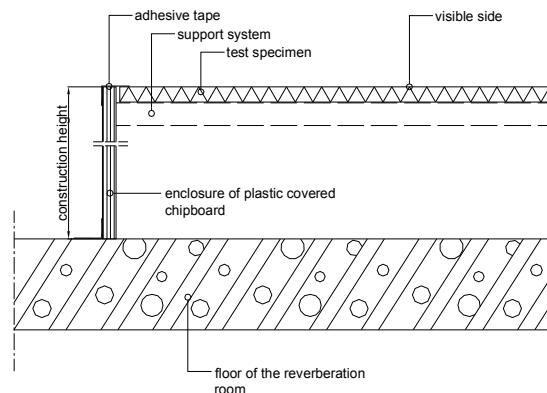

f4.1 measurement set-up

The measurement setups are according to type E-200 ISO 354:2003 (Test specimen mountings for sound absorption tests).

4.1 Method

The tests were conducted in accordance with the provisions of the test method ISO 354 in the reverberation room of "Peutz bv" in Mook (the Netherlands) (see figure 1). The relevant data regarding the reverberation room are given in figure 3 of this report.

By means of reverberation measurements the reverberation time of the room is measured under two conditions:

- when the reverberation room is empty
- when the construction under test is inside the reverberation room

In general, once material is placed into the reverberation room a lower reverberation time will result.

The difference in reverberation times is a measure of the amount of absorption brought into the room.

Measurements and calculations were carried out in 1/3-octave bandwidth from 100 to 5000 Hz, according to the norms. Where applicable the octave values have been calculated from these 1/3-octave values.



From the reverberation measurements in the empty reverberation room the equivalent sound absorption A_1 is calculated (per frequency band) according to formula 1 and expressed in m^2

$$A_1 = \frac{55,3V}{cT_1} - 4Vm_1 \quad (1)$$

in which:

V = the volume of the reverberation room $[\text{m}^3]$

T_1 = the reverberation time in the empty reverberation room $[\text{sec.}]$

m_1 = "power attenuation coefficient" in the empty room,
calculated according to formula $[\text{m}^{-1}]$

c = the speed of sound in the air, in m/s , calculated according to $[\text{m/s}]$

$$c = 331 + 0,6t \quad (2)$$

in which:

t = the temperature; this formula is valid for temperatures between 15 and 30 $^\circ\text{C}$ $[\text{°C}]$

$$m = \frac{\alpha}{10 \log(e)} \quad (3)$$

in which:

α = "attenuation coefficient" according to ISO 9613-1

In the same manner the equivalent sound absorption A_2 for the room with the test specimen is calculated according to formula 4, also expressed in m^2

$$A_2 = \frac{55,3V}{cT_2} - 4Vm_2 \quad (4)$$

in which:

c and V have the same definition as in formula 1 and

T_2 = the reverberation time of the reverberation room with the test specimen placed inside $[\text{sec}]$

m_2 = "power attenuation coefficient" in the room with the test specimen placed inside, calculated according to formula 3 $[\text{m}^{-1}]$

The equivalent sound absorption A of the test specimen has been calculated according to formula 5 and is expressed in m^2

$$A = A_2 - A_1 \quad (5)$$

When the test specimen consists of one plane with an area between 10 and 12 m^2 the sound absorption coefficient α_s has to be calculated according to formula 6:

$$\alpha = \frac{A}{S} \quad (6)$$

in which:

S = the area of the test specimen [m²]

4.2 Accuracy

The accuracy of the sound absorption as calculated can be expressed in terms of repeatability (tests within one laboratory) and reproducibility (between various laboratories).

When:

- two tests are performed on identical test material
- within a short period of time
- by the same person or team
- using the same instrumentation
- under unchanged environmental conditions

the probability will be 95% that the difference between the two test results will be less than or equal to r .

In order to evaluate the repeatability r for the sound absorption measurements performed in the reverberation room of "Peutz bv" in Mook (the Netherlands) eight series of measurements have been carried out according to ISO 354:1985 annex C. From the results of those measurements the repeatability r has been calculated. It was found that for the frequency range from 100 to 200 Hz and at 5000 Hz the repeatability r is 0,21 as a maximum. For the frequency range 250 to 4000 Hz the repeatability r is 0,09 as a maximum.

4.3 Environmental conditions during the measurements

4.3.1 Environmental conditions during the measurements

reverberation room	temperature [°C]	barometric pressure [kPa]	relative humidity [%]
empty	18	102,3	51
occupied	18	102,5	51 - 54

4.4 Results

The results of the measurements are given in table 4.2 and 4.3 and in the figures 3 up to and including 10. The measurements were made in 1/3-octave bands. The results presented in octave-bands are the arithmetic average of the results of the three 1/3-octave bands belonging to that octaveband. From those values the following one-figure ratings have been calculated and stated :

- the "weighted sound absorption coefficient α_w " according to ISO 11654;
- the "Noise Reduction Coefficient NRC" according to ASTM-C423, being the average of the absorption coefficients (1/3 octave values) at the frequencies of 250, 500, 1000 and 2000 Hz, rounded to the nearest 0,05;

- the "Sound Absorption Average SAA" according to ASTM-C423, being the average of the absorption coefficients (1/3 octave values) at the frequencies of 200 Hz up to and including 2500 Hz, rounded to the nearest 0,01.

t4.2 Measurement result (construction height 200 mm)

sound absorption coefficient α_s								
measurement nr.	1 42 mm		2 60 mm		3 70 mm		4 70 mm joint filler	
c.c.t. distance								
extra	-		-		-			
record nr.	#409		#410		#411		#412	
figure nr.	3		4		5		6	
frequency [Hz]	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.
100	0,24		0,02		-0,01		0,00	
125	0,35	0,38	0,08	0,10	0,06	0,06	0,12	0,12
160	0,54		0,21		0,14		0,25	
200	0,57		0,27		0,21		0,35	
250	0,75	0,72	0,36	0,41	0,29	0,34	0,55	0,56
315	0,85		0,61		0,51		0,78	
400	1,00		0,75		0,66		0,87	
500	0,90	0,94	0,53	0,63	0,47	0,56	0,88	0,91
630	0,92		0,62		0,54		0,97	
800	0,73		0,55		0,53		0,98	
1000	0,72	0,77	0,52	0,60	0,50	0,58	1,04	1,01
1250	0,87		0,73		0,72		1,02	
1600	0,91		0,82		0,79		0,91	
2000	0,93	0,93	0,82	0,85	0,78	0,81	0,89	0,91
2500	0,94		0,90		0,86		0,93	
3150	0,91		0,91		0,85		1,00	
4000	0,93	0,91	0,92	0,91	0,90	0,87	1,01	0,99
5000	0,89		0,90		0,86		0,95	
α_w	0,85		0,65(H)		0,60(H)		0,85(H)	
NRC	0,80		0,55		0,50		0,85	
SAA	0,84		0,62		0,57		0,85	

t4.3 Measurement result (construction height 200 mm)

sound absorption coefficient α_s							
measurement nr.	5 70 mm		6 80 mm		7 80 mm joint filler		8 90 mm
c.c.t. distance extra	glass wool on top (cavity side)		-		#415		-
record nr.	#413		#414		#415		#416
figure nr.	7		8		9		10
frequency [Hz]	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.	1/3 oct.
100	0,07		0,01		0,08		0,00
125	0,38	0,36	0,03	0,05	0,24	0,25	0,02 0,04
160	0,64		0,12		0,43		0,11
200	0,62		0,16		0,46		0,14
250	0,84	0,82	0,23	0,27	0,64	0,63	0,20 0,23
315	1,00		0,41		0,79		0,36
400	0,96		0,57		0,88		0,50
500	1,00	1,00	0,41	0,48	0,89	0,89	0,38 0,43
630	1,04		0,47		0,90		0,42
800	1,03		0,45		0,80		0,42
1000	1,03	1,03	0,43	0,50	0,73	0,79	0,41 0,47
1250	1,02		0,63		0,85		0,59
1600	0,99		0,73		0,95		0,71
2000	1,01	1,01	0,73	0,75	0,93	0,97	0,68 0,71
2500	1,02		0,80		1,02		0,75
3150	1,03		0,80		0,98		0,75
4000	1,07	1,04	0,83	0,82	0,99	0,97	0,81 0,79
5000	1,02		0,84		0,95		0,81
α_w	1,00		0,50(H)		0,85		0,45(H)
NRC	0,95		0,45		0,80		0,40
SAA	0,96		0,50		0,82		0,46



The sound absorption coefficient of a material is not a material property. It should be taken into account that the sound absorption of a construction depends on the dimensions, the way of mounting of the material and its position in the room.

Mook,

A blue ink signature of the name 'Th. Scheers'.

Th. Scheers
Laboratory Supervisor

A blue ink signature of the name 'dr. ir. M.L.S. Vercammen'.


dr. ir. M.L.S. Vercammen
Manager

This report contains 13 pages and 10 figures.


PEUTZ bv
Lindenlaan 41, NL-6584 AC MOLENHOEK (LB), THE NETHERLANDS

OVERVIEW

Story

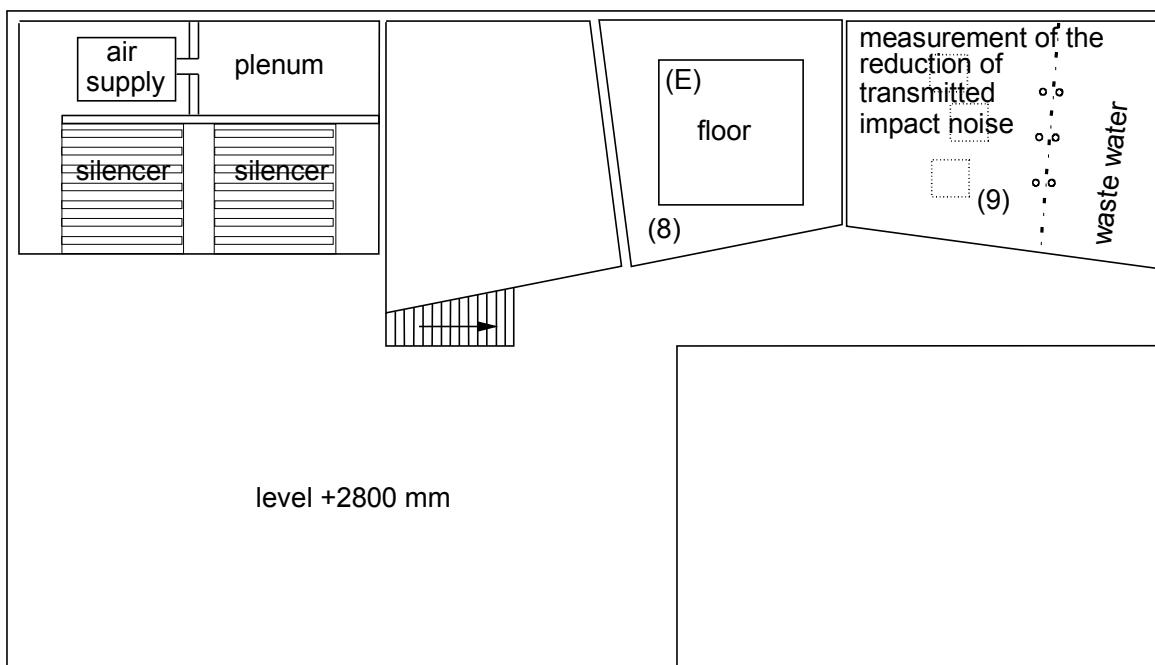

Ground level

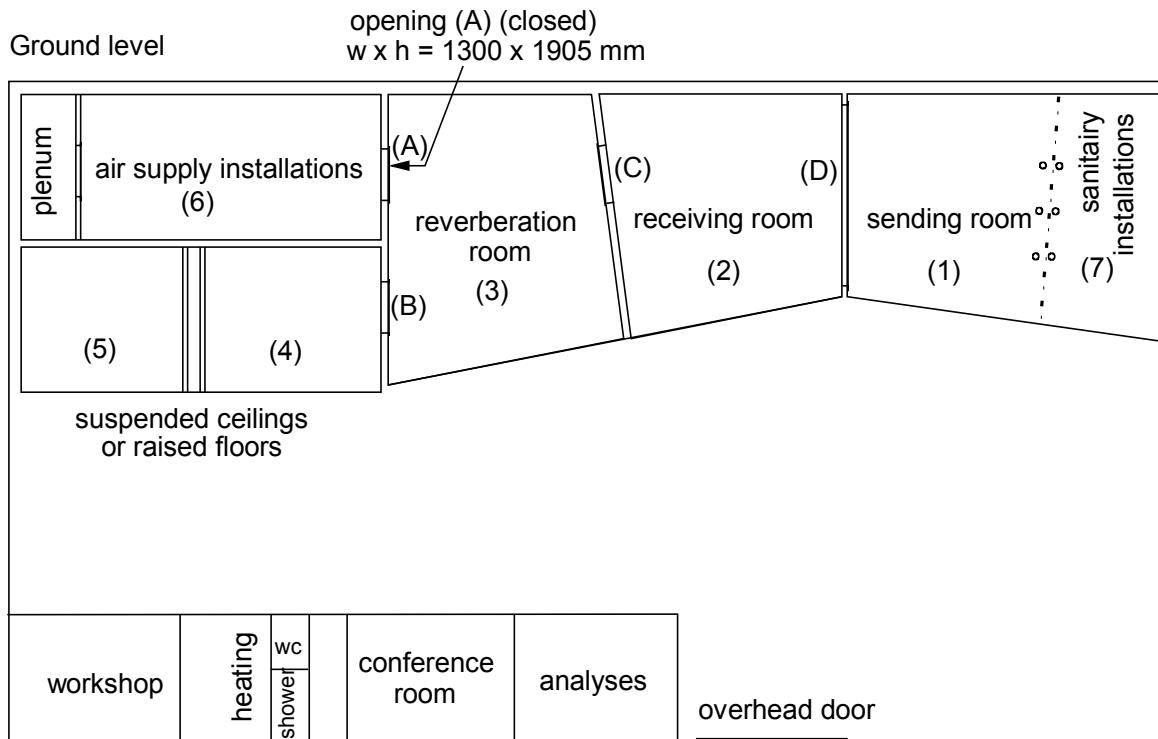

TEST OPENINGS (w x h in mm)

- (B) 1000 x 2200
- (C) 1500 x 1250
- (D) 4300 x 2800
- (E) 4000 x 4000

0 1 2 3 4 5 m
scale

PEUTZ bv
Lindenlaan 41, 6584 AC MOLENHOEK (LB)

REVERBERATION ROOM

The reverberation room meets the requirements of ISO 354:2003.

additional data:

volume : 214 m^3

total area S_t (walls, floor and ceiling) : 219 m^2

diffusion: by the shape of the room and by adding 6 curved and 2 flat reflecting elements with a total area of approx. 13 m^2 a sufficient diffusion has been gained.



reverberation time of the empty reverberation room during measurements of 14-12-2016

frequency (1/1 oct.)	125	250	500	1000	2000	4000	Hz
reverberationtime	7,62	6,20	5,92	5,37	4,09	2,62	sec.

repeatability r (1/1 oct.) c.f. ISO 354:1985 annex C (see chapter 4.2 of this report).

r bij hoge α	0,13	0,04	0,04	0,02	0,02	0,08	-
r bij lage α	0,09	0,02	0,01	0,02	0,02	0,04	-

plan

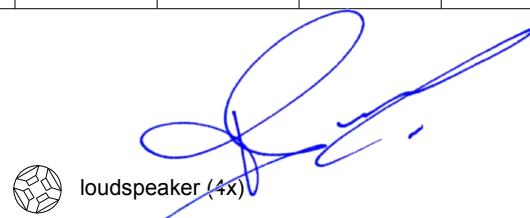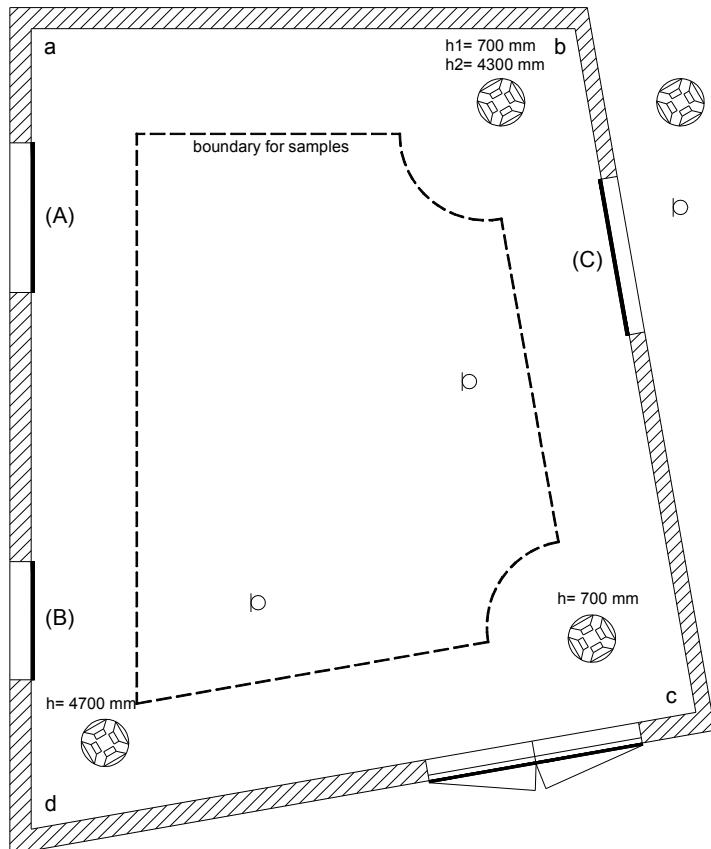

○ microphone (3x)

(closed) testopenings

(width x height in mm)

(A): 1300 x 1800

(B): 1000 x 2200

(C): 1500 x 1250

height at:

a: 5573 mm

b: 5102 mm

c: 5000 mm

d: 5580 mm



0 1 2m

**MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003**


principal: Hunter Douglas Europe B.V. - Rotterdam

#1;HeartFelt® panels: c.t.c. distance 42 mm, construction height 200 mm

type: HeartFelt® Panels
 manufacturer: Hunter Douglas Europe B.V.
 panel sizes: a square edged U-profile height 55 mm, width 40 mm
 material: Trevira Polyester fiber felt

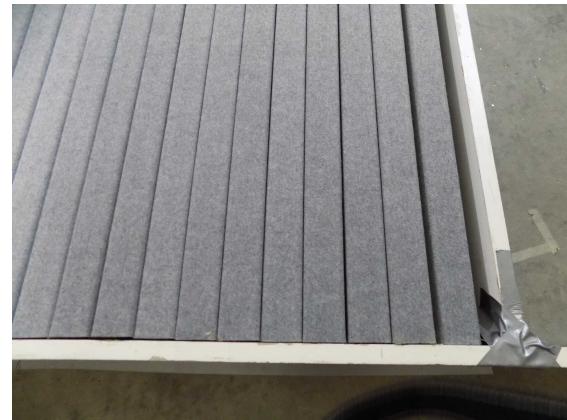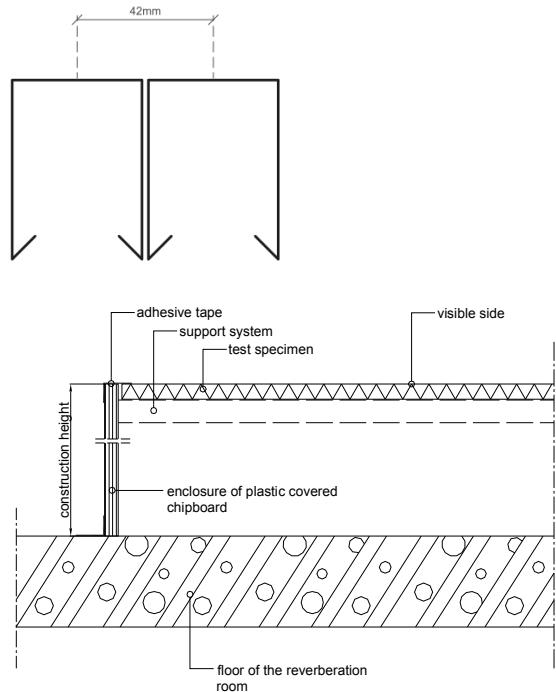
Absorb, versie 5.8.4 mode 7, PM:RA, file: 33211 E#3-38 F#372-407 A#408 T₁ = 17,6 °C T₂ = 18,0 °C p₁ = 102,3 kPa p₂ = 102,5 kPa h₁ = 51,3 % h₂ = 53,6 %volume reverberation room: 214 m³surface area sample: 10,8 m²

height of the construction: 0,200 m

measured at: Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

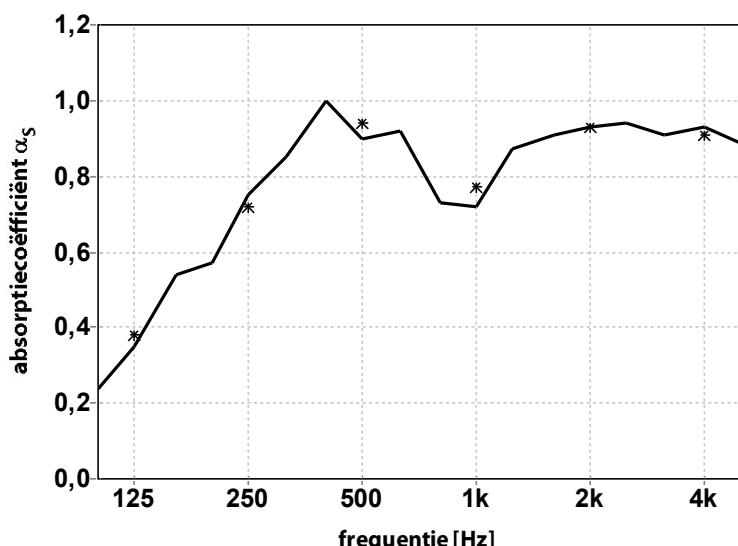 α_w (ISO 11654) = 0,85**NRC (ASTM - C423) = 0,80****SAA (ASTM - C423) = 0,84**

1/3 oct.	0,24	0,57	1,00	0,73	0,91	0,91
1/3 oct.	0,35	0,75	0,90	0,72	0,93	0,93
1/3 oct.	0,54	0,85	0,92	0,87	0,94	0,89
1/1 oct.	0,38	0,72	0,94	0,77	0,93	0,91

publication is permitted for the entire page only


Mook, measured at 14-12-2016

**MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003**


principal: Hunter Douglas Europe B.V. - Rotterdam

#2;HeartFelt® panels: c.t.c. distance 60 mm, construction height 200 mm

type: HeartFelt® Panels
 manufacturer: Hunter Douglas Europe B.V.
 panel sizes: a square edged U-profile height 55 mm, width 40 mm
 material: Trevira Polyester fiber felt

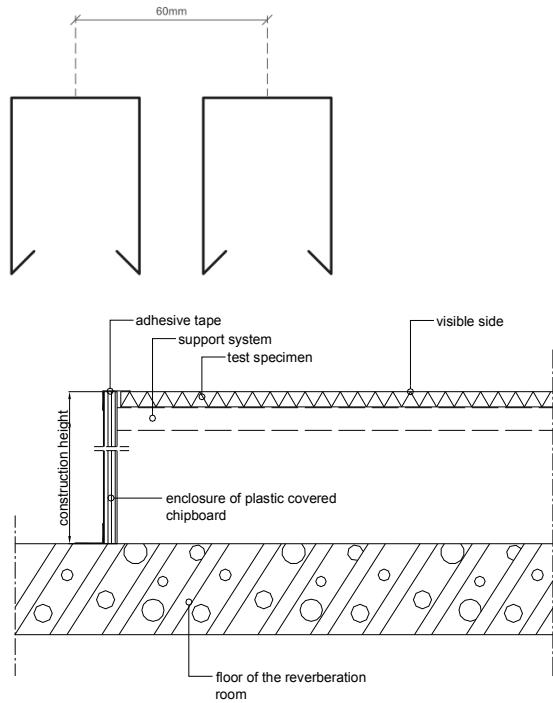
Absorb, versie 5.8.4 mode 7, PM:RA, file: 33211 E#3-38 F#224-259 A#260 T₁ = 18,0 °C p₁ = 102,3 kPa p₂ = 102,5 kPa h₁ = 51,3 % h₂ = 53,1 %volume reverberation room: 214 m³surface area sample: 10,8 m²

height of the construction: 0,200 m

measured at: Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

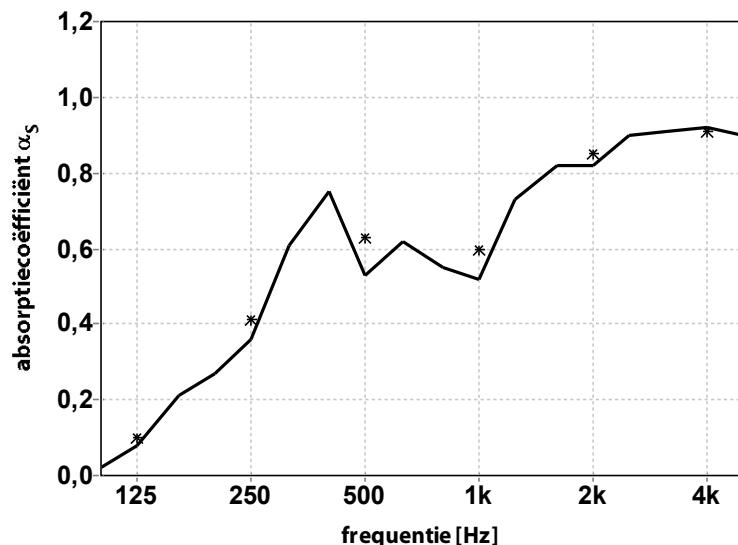 α_w (ISO 11654) = 0,65(H)**NRC (ASTM - C423) = 0,55****SAA (ASTM - C423) = 0,62**

	1/3 oct.	0,10	0,41	0,63	0,60	0,85	0,91
1/3 oct.	0,02	0,27	0,75	0,55	0,82	0,91	
	0,08	0,36	0,53	0,52	0,82	0,92	
	0,21	0,61	0,62	0,73	0,90	0,90	

publication is permitted for the entire page only

Mook, measured at 14-12-2016

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM ACCORDING TO ISO 354:2003



principal: Hunter Douglas Europe B.V. - Rotterdam


#3;HeartFelt® panels: c.t.c. distance 70 mm, construction height 200 mm

type: HeartFelt® Panels

manufacturer: Hunter Douglas Europe B.V.

panel sizes: a square edged U-profile height 55 mm, width 40 mm

material: Trevira Polyester fiber felt

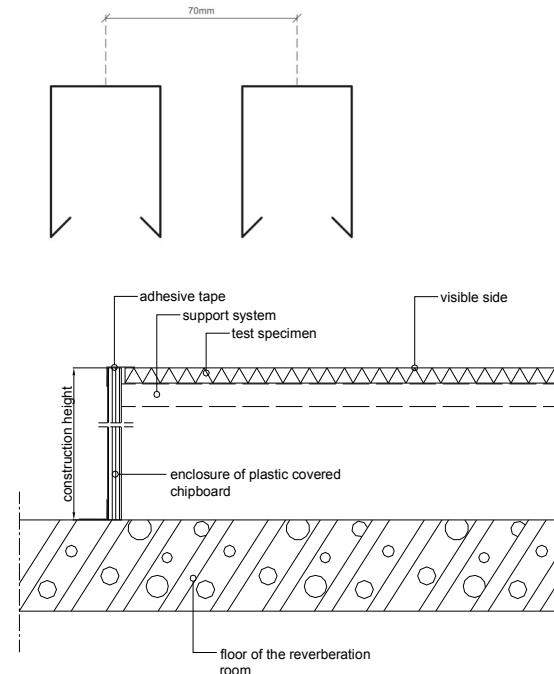

Absorb, versie 5.8.4 mode 7, PM:RA, file: a3211 E#3-38 F#:187-222 A#223 T₁ = 17,6 °C T₂ = 17,8 °C p₁ = 102,3 kPa p₂ = 102,5 kPa h₁ = 51,3 % h₂ = 52,7 %

volume reverberation room: 214 m³

surface area sample: 10,8 m²


height of the construction: m

measured at: Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,60(H)

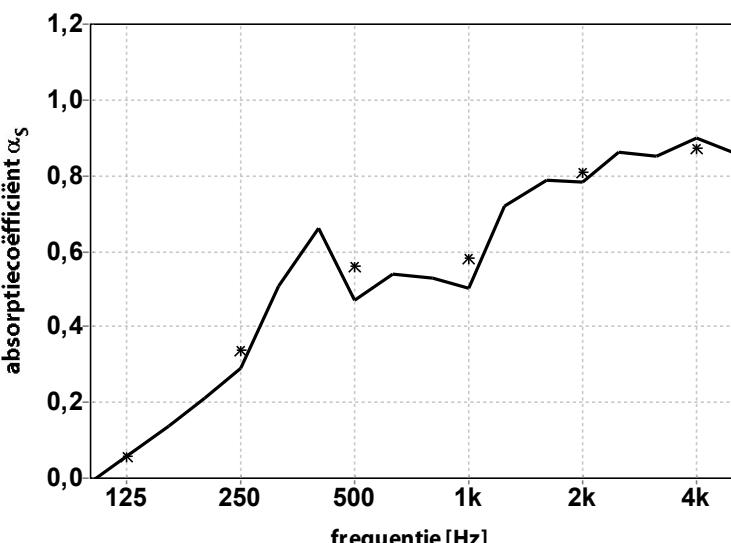

NRC (ASTM - C423) = 0,50

1/3 oct. -0,01 0,21 0,66 0,53 0,79 0,85
0,06 0,29 0,47 0,50 0,78 0,90
0,14 0,51 0,54 0,72 0,86 0,86

SAA (ASTM - C423) = 0,57

1/1 oct. 0,06 0,34 0,56 0,58 0,81 0,87

publication is permitted for the entire page only



Mook, measured at 14-12-2016

**MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003**


principal: Hunter Douglas Europe B.V. - Rotterdam

#4;HeartFelt® panels: c.t.c. distance 70 mm, with joint filler, construction height 200 mm

type: HeartFelt® Panels
 manufacturer: Hunter Douglas Europe B.V.
 panel sizes: a square edged U-profile height 55 mm, width 40 mm
 material: Trevira Polyester fiber felt

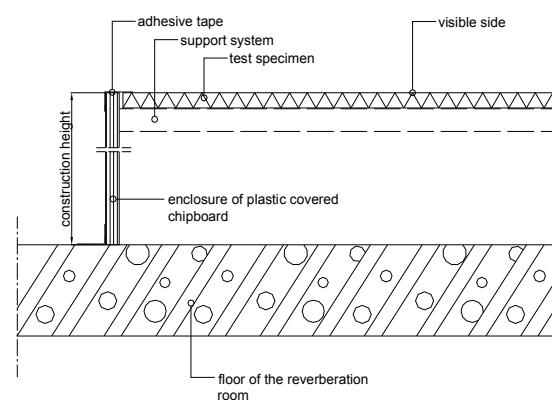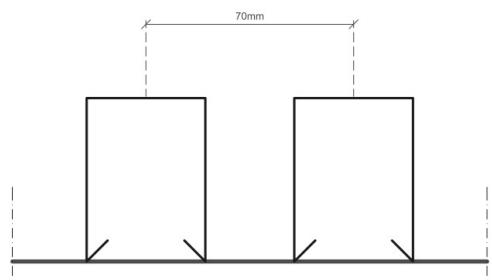
 Absorb, versie 5.8.4 mode 7, PM:RA, file: 33211 E#3-38 F#150-185 A#186 T₁ = 17,6 °C T₂ = 18,1 °C p₁ = 102,3 kPa p₂ = 102,5 kPa h₁ = 51,3 % h₂ = 52,1 %

 volume reverberation room: 214 m³

 surface area sample: 10,8 m²

height of the construction: 0,200 m

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

 α_w (ISO 11654) = 0,85(H)

NRC (ASTM - C423) = 0,85


SAA (ASTM - C423) = 0,85

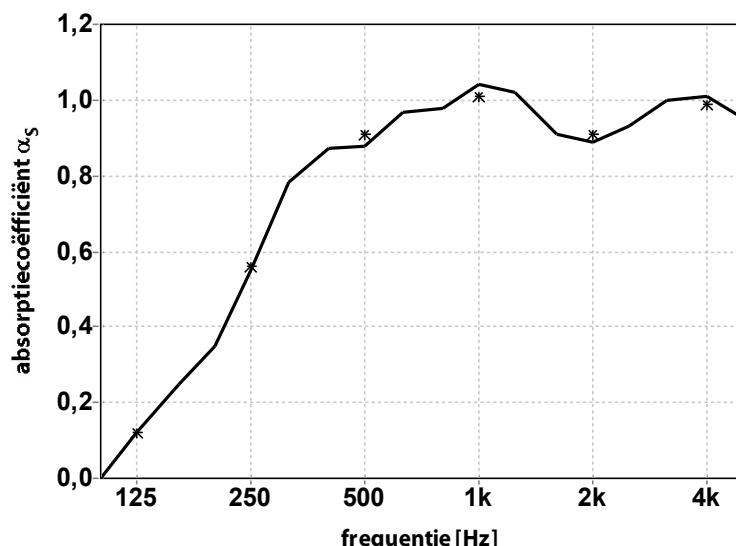

1/3 oct.	0,00	0,35	0,87	0,98	0,91	1,00
	0,12	0,55	0,88	1,04	0,89	1,01
	0,25	0,78	0,97	1,02	0,93	0,95

1/1 oct.	0,12	0,56	0,91	1,01	0,91	0,99
----------	------	------	------	------	------	------

publication is permitted for the entire page only


 Mook, measured at 14-12-2016



MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM ACCORDING TO ISO 354:2003



principal: Hunter Douglas Europe B.V. - Rotterdam

#5;HeartFelt® panels: c.t.c. distance 70 mm, with 22 mm glass wool, construction height 200 mm

type: HeartFelt® Panels
 manufacturer: Hunter Douglas Europe B.V.
 panel sizes: a square edged U-profile height 55 mm, width 40 mm
 material: Trevira Polyester fiber felt

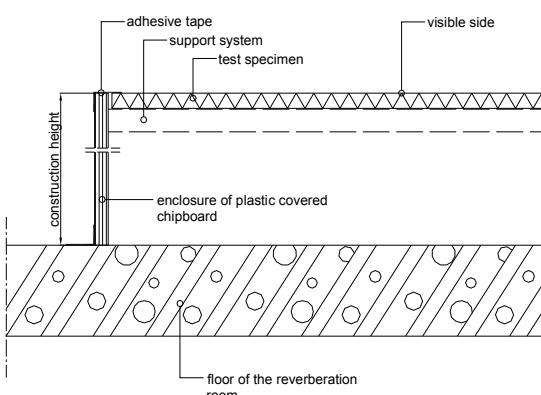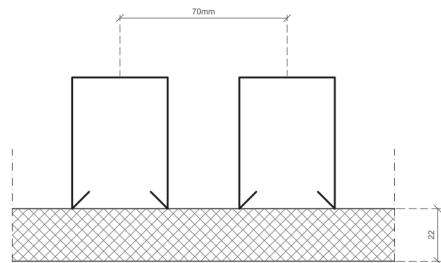

A3211-1E-RvA-001_rvca19891/THEO

volume reverberation room: 214 m³


surface area sample: 10,8 m²

height of the construction: m

measured at: Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

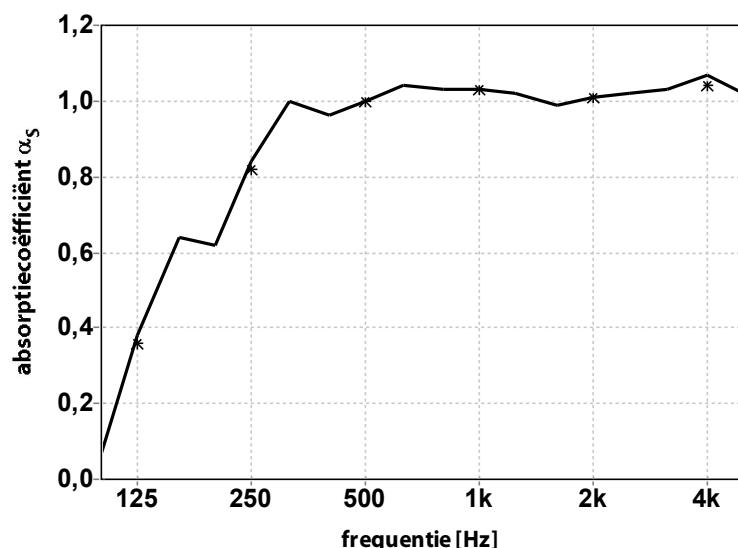

α_w (ISO 11654) = 1,00

1/3 oct.	0,07 0,38 0,64	0,62 0,84 1,00	0,96 1,00 1,04	1,03 1,03 1,02	0,99 1,01 1,02	1,03 1,07 1,02
----------	----------------------	----------------------	----------------------	----------------------	----------------------	----------------------

NRC (ASTM - C423) = 0,95

1/1 oct.	0,36	0,82	1,00	1,03	1,01	1,04
----------	-------------	-------------	-------------	-------------	-------------	-------------

SAA (ASTM - C423) = 0,96

publication is permitted for the entire page only


Mook, measured at 14-12-2016

**MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003**


principal: Hunter Douglas Europe B.V. - Rotterdam

#6;HeartFelt® panels: c.t.c. distance 80 mm, construction height 200 mm

type: HeartFelt® Panels
 manufacturer: Hunter Douglas Europe B.V.
 panel sizes: a square edged U-profile height 55 mm, width 40 mm
 material: Trevira Polyester fiber felt

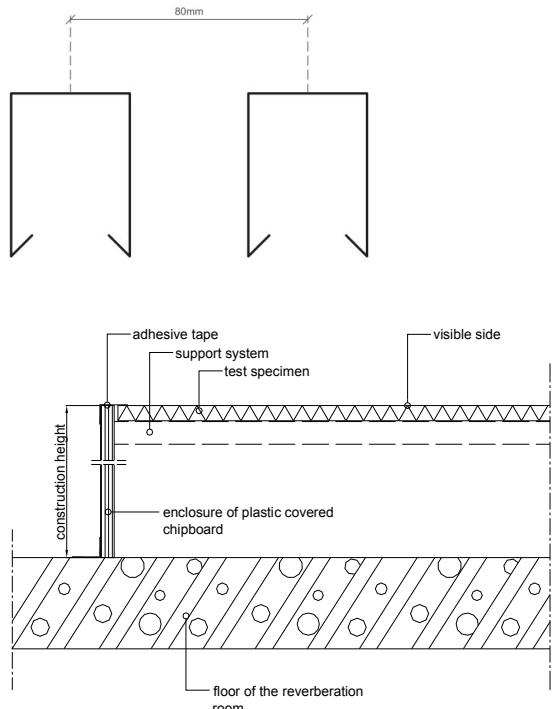
 Absorb, versie 5.8.4 mode 7, PM:RA, file: 33211 E#338 F#298-333 A#334 T₁ = 17,6 °C T₂ = 18,0 °C p₁ = 102,3 kPa p₂ = 102,5 kPa h₁ = 51,3 % h₂ = 53,2 %
volume reverberation room: 214 m³surface area sample: 10,8 m²

height of the construction: m

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

 α_w (ISO 11654) = 0,50(H)

NRC (ASTM - C423) = 0,45

SAA (ASTM - C423) = 0,50

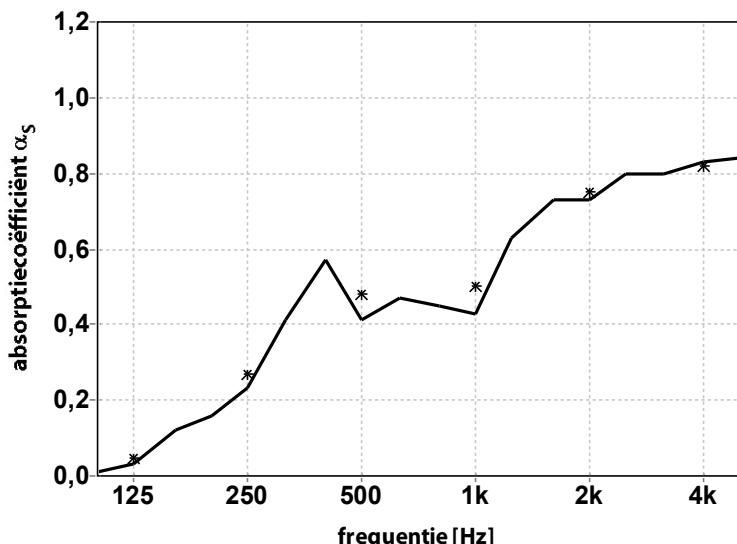

	1/3 oct.	0,05	0,27	0,48	0,50	0,75	0,82
NRC (ASTM - C423)	0,01	0,16	0,57	0,45	0,73	0,80	0,83

publication is permitted for the entire page only



Mook, measured at 14-12-2016

**MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003**


principal: Hunter Douglas Europe B.V. - Rotterdam

#7; HeartFelt® panels: c.t.c. distance 80 mm, with joint filler, construction height 200 mm

type: HeartFelt® Panels
 manufacturer: Hunter Douglas Europe B.V.
 panel sizes: a square edged U-profile height 55 mm, width 40 mm
 material: Trevira Polyester fiber felt

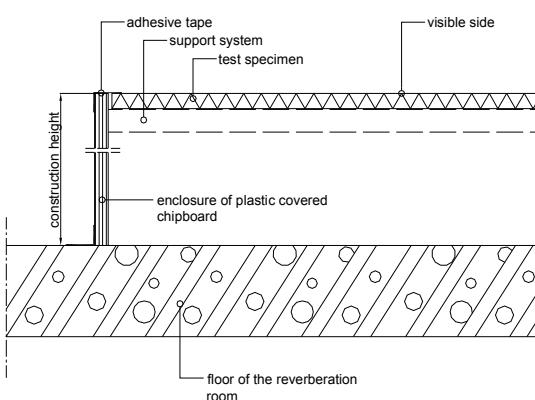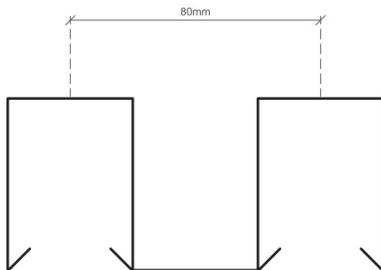
Absorb, versie 5.8.4 mode 7, PM:RA, file: 33211 E#3-38 F#3355-370 A#371 T₁ = 17,6 °C T₂ = 18,0 °C p₁ = 102,3 kPa p₂ = 102,5 kPa h₁ = 51,3 % h₂ = 53,8 %volume reverberation room: 214 m³surface area sample: 10,8 m²

height of the construction: m

measured at: Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

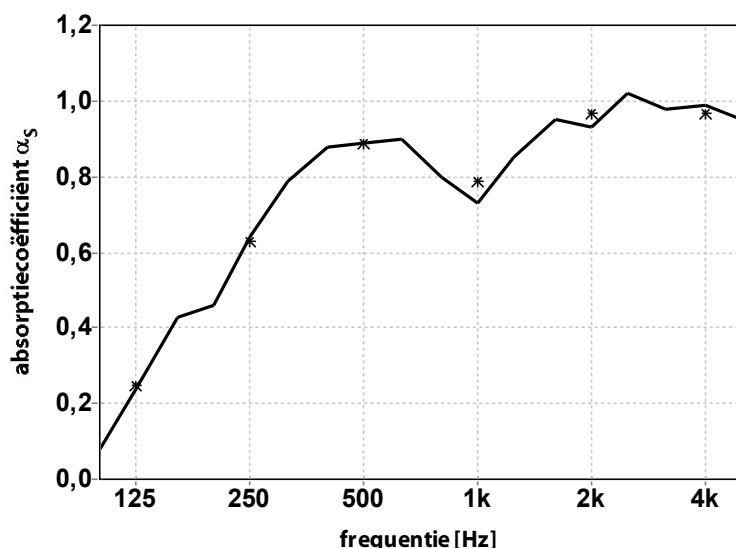 α_w (ISO 11654) = 0,85**NRC (ASTM - C423) = 0,80****SAA (ASTM - C423) = 0,82**

	1/3 oct.	1/1 oct.
1/3 oct.	0,08	0,24
	0,46	0,64
	0,88	0,89
	0,80	0,73
	0,95	0,93
	0,98	0,99
1/1 oct.	0,43	0,79
	0,90	0,85
	1,02	0,97
	0,95	0,95

publication is permitted for the entire page only

Mook, measured at 14-12-2016


MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM ACCORDING TO ISO 354:2003



principal: Hunter Douglas Europe B.V. - Rotterdam

#8;HeartFelt® panels: c.t.c. distance 90 mm, construction height 200 mm

type: HeartFelt® Panels
 manufacturer: Hunter Douglas Europe B.V.
 panel sizes: a square edged U-profile height 55 mm, width 40 mm
 material: Trevira Polyester fiber felt

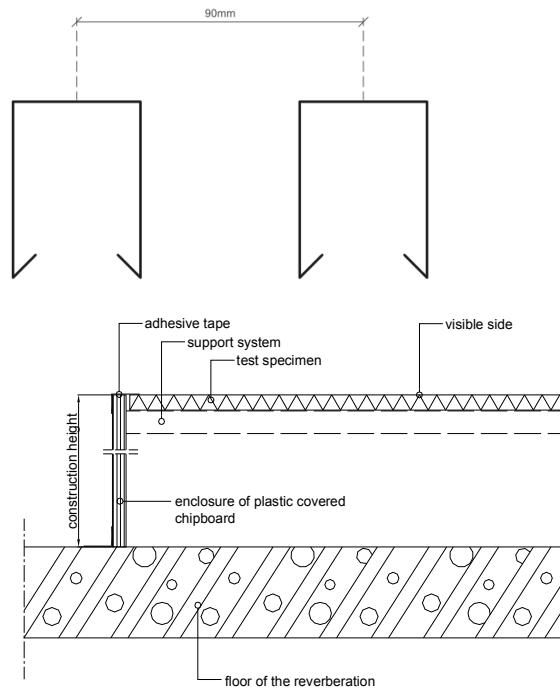

Absorb, versie 5.8.4 mode 7, PM:RA, file: 33211 E#3-38 F#261-296 A#297 T₁ = 17,6 °C p₁ = 102,3 kPa h₁ = 51,3 % h₂ = 53,2 %

volume reverberation room: 214 m³

surface area sample: 10,8 m²

height of the construction: m

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,45(H)

NRC (ASTM - C423) = 0,40

SAA (ASTM - C423) = 0,46

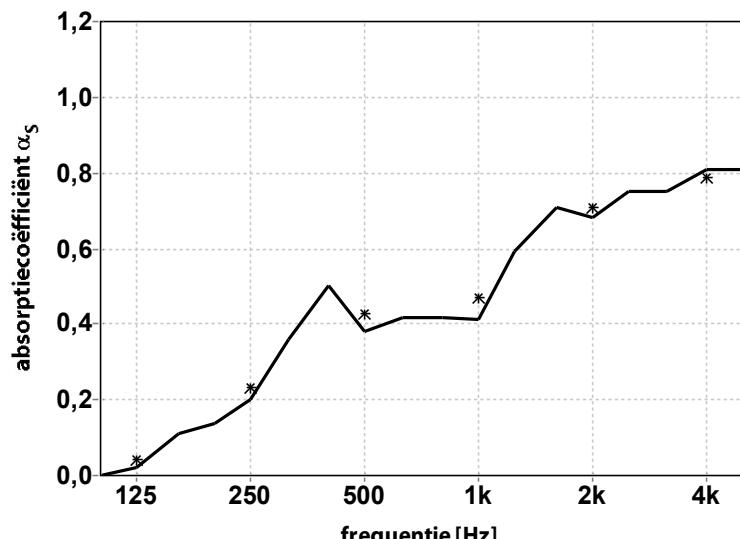

	1/3 oct.	0,04	0,23	0,43	0,47	0,71	0,79
NRC (ASTM - C423)	0,02	0,20	0,38	0,41	0,68	0,81	0,81

publication is permitted for the entire page only

Mook, measured at 14-12-2016